


- NOTES:**
1. MATERIALS SHALL BE SUBMITTED FOR CITY APPROVAL PRIOR TO INSTALLATION.
 2. MATERIAL SHALL BE NON-LEAD, SUPPLIERS ARE TYPICALLY: FORD, MEULLER, AND AY MCDONALD.
 3. MATCH BALL VALVE SIZE TO CTS POLY, 1- $\frac{1}{2}$ INCH BY 1-INCH U-BRANCH SET 12-INCH ON CENTER CONNECTED TO 1 $\frac{1}{2}$ INCH BALL VALVE NEAR CHAMBER WALL AND WITH 1-INCH BALL VALVES ON EACH BRANCH.
 4. DOWNSTREAM WATER SERVICE PIPE DIAMETER SHALL BE THE SAME AS THE WATER METER FOR TEN (10) FEET.
 5. 1 $\frac{1}{2}$ INCH BALL VALVE COMPRESSION COUPLING TO THE CTS PE SERVICE PIPE SHALL BE A MAXIMUM OF 2-INCHES FROM SIDE OF CHAMBER WALL.
 6. ALL TAPS SHALL BE BY CITY CREWS

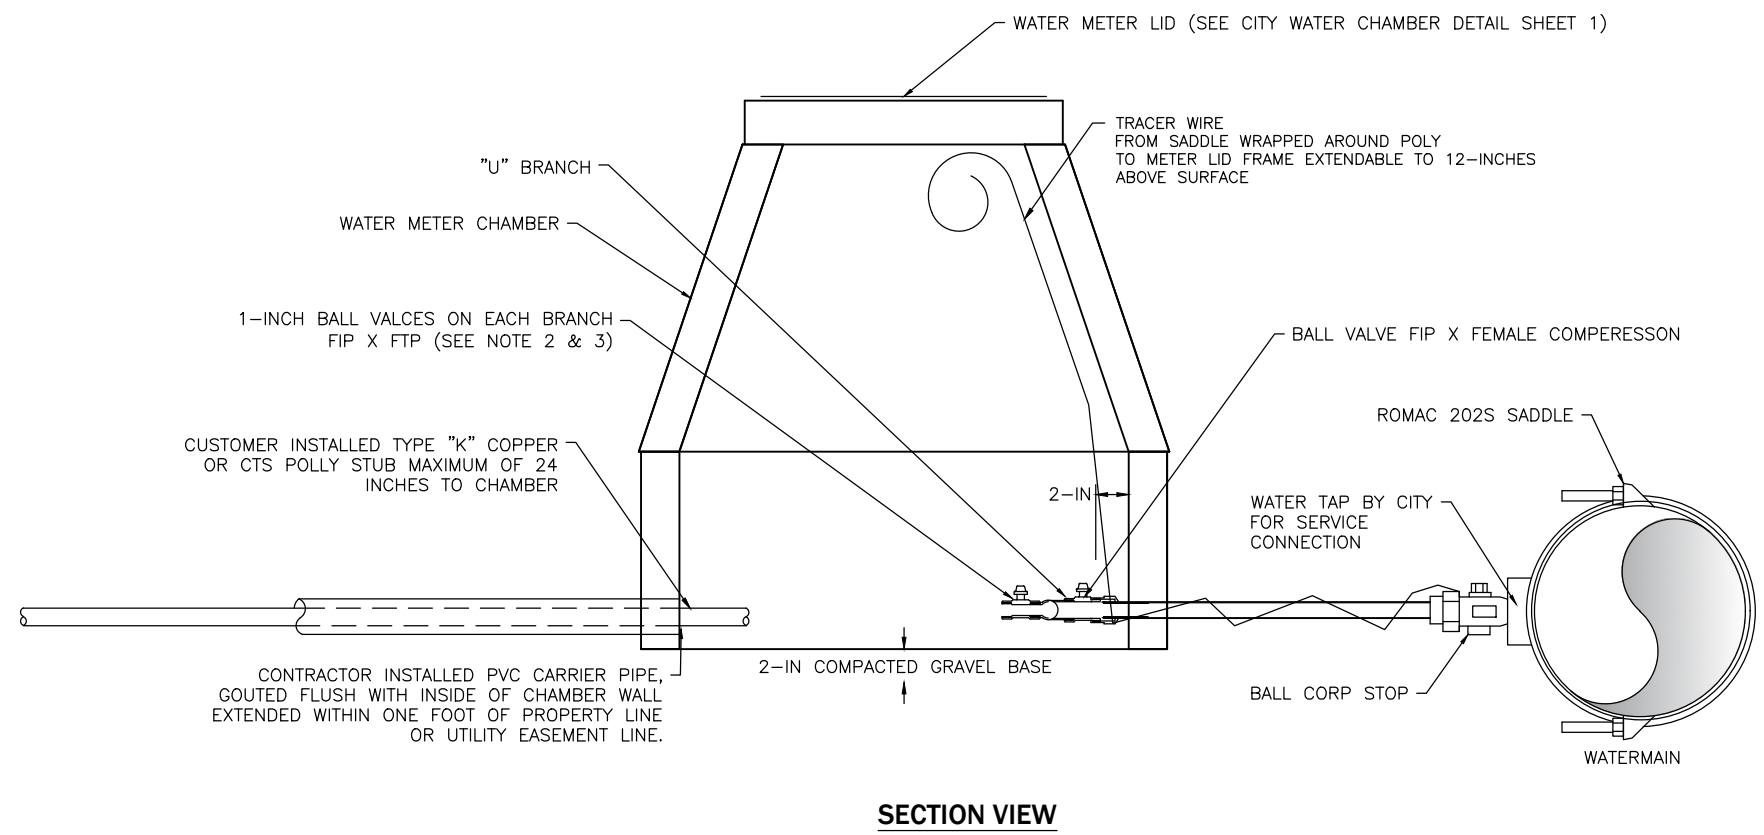

STANDARD DETAIL

2 1" SPLIT FROM 1 1/2" DOUBLE METER SERVICE

WATER METER SERVICES

SCALE: AS SHOWN		DATE DRAWN		DATE		REVISIONS	
DESIGNED	MYW	3/06/2017	3/06/2017	DATE	INITIAL		
CHECKED	MYW	04/26/2017	04/26/2017	DATE	INITIAL		
APPROVED BY	MYW	01/01/2022	01/01/2022	DATE	INITIAL		

DETAIL NO. **W-250C**

PAGE **3 OF 4**

STANDARD SPECIFICATIONS

7-09 WATER MAINS

9-30.6 WATER SERVICE CONNECTIONS